

VARIMETER Voltage Relay BA 9054

Translation
of the original instructions



Your Advantages

- Protection against defect by overvoltage
- Preventive maintenance
- For better productivity
- Quicker fault locating
- Precise and reliable


Features

- According to IEC/EN 60255-1, IEC/EN 60947-1
- To: monitor DC and AC
- With measuring ranges from 15 mV to 1000 V
- High overload possible
- Input frequency up to 5 kHz
- Galvanic separation between Auxiliary Circuit – measuring circuit
- Auxiliary supply AC and AC/DC
- Optionally with start-up delay
- With time delay, up to max. 100 sec
- Optionally with safe separation to IEC/EN 61140 (on request)
- As option with manual reset
- LED indicators for operation and contact position
- Width: 45 mm

Product Description

The voltage relay BA 9054 of the VARIMETER series monitors single phase DC or AC voltage systems. The adjustment is made via potentiometers on the front of the device. Early recognition and preventive maintenance avoid interruptions of electrical plants and provides a higher operational and plant safety.


Circuit Diagrams

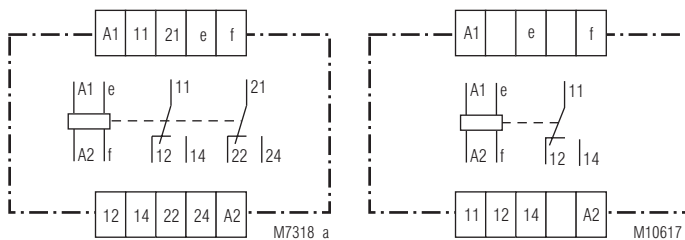

BA 9054

BA 9054/_ 2 _

Approvals and Markings



¹⁾ Approval not for all variants

Applications

- Monitoring voltage in AC or DC systems
- For industrial and railway applications

Connection Terminals

Terminal designation	Signal description
A1, A2	Auxiliary voltage
e, f	Voltage measuring input
11, 12, 14	1st changeover contact
21, 22, 24	2nd changeover contact

Function


The relays measure the arithmetic mean value of the rectified measuring voltage. The AC units are adjusted to the r.m.s value. They have settings for response value and hysteresis. The units work as overvoltage relays but can also be used for undervoltage detection. The hysteresis is dependent on the response value.

2 time delays are possible in different variants:
The start up delay t_a operates only when connecting the auxiliary supply. The response delay t_v is active after exceeding a response value. On overvoltage relays the delay is active when the voltage goes over the tripping value, on undervoltage relays when the voltage drops below the hysteresis value.


Indicators

- Green upper LED: On, when auxiliary supply connected
- Yellow lower LED: On, when output relay acitvated

Function Diagram without Start-up Delay

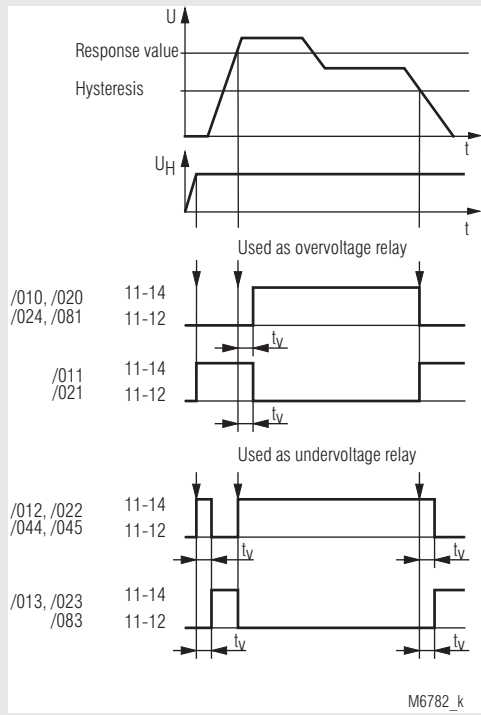

Function Diagram with Start-up Delay

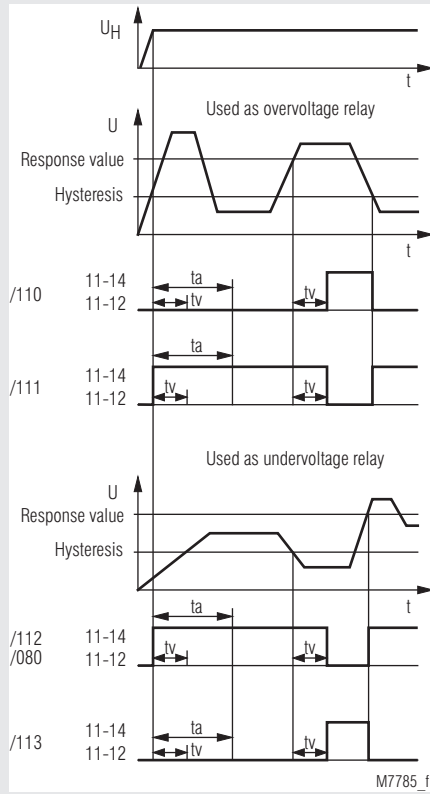

Version BA 9054/_1_: 2 changeover contacts

Version BA 9054/_20, /_21, /_22, /_23, /_24: 1 changeover contact, measuring range $\geq 70 \dots 700 \text{ V}$

At version BA 9054/6__ with manual reset the contacts remain in the fault state after detecting a fault or after t_a has elapsed. The contacts are reset by disconnecting the supply voltage.

Technical Data

Input (e, f)

With 1 Measuring range for AC and DC			
Measuring range ¹⁾		internal resistance	max. permissible contin. voltage
AC	DC		
6 ... 60 mV	5,4 ... 54 mV	20 kΩ	10 V
15 ... 150 mV	13,5 ... 135 mV	40 kΩ	100 V
50 ... 500 mV	45 ... 450 mV	270 kΩ	250 V
0,5 ... 5 V	0,45 ... 4,5 V	500 kΩ	300 V
1 ... 10 V	0,9 ... 9,0 V	1 MΩ	300 V
5 ... 50 V	4,5 ... 45 V	2 MΩ	500 V
25 ... 250 V	22,5 ... 225 V	2 MΩ	500 V
50 ... 500 V	45 ... 450 V	2 MΩ	500 V
70 ... 700 V ²⁾	63 ... 630 V ²⁾	3 MΩ	1000 V
100 ... 1000 V ²⁾	90 ... 900 V ²⁾	3 MΩ	1000 V

¹⁾ DC or AC voltage 50 ... 5000 Hz
(Other frequency ranges of 10 ... 5000 Hz, e.g. 16^{2/3} Hz on request)

²⁾ only with BA 9054/_20; /_21; /_22; /_23; /_24
(Version: 1 changeover contact)

Please note:

- ≤ 600 V: Overvoltage category III
- > 600 V: Overvoltage category II
- Measuring ranges 6 ... 60 mV only available at variant BA 9054/08_ (Using only for current sensing via shunt!)

Measuring principle: Arithmetic mean value
Adjustment: The AC-devices can also monitor DC-voltage. The scale offset in this case is ($U = 0.90 U_{\text{eff}}$)
Temperature influence: < 0.05 % / K

Setting Ranges

Setting

Response value: Infinite variable 0.1 U_N ... 1 U_N
relative scale

Hysteresis
at AC: Infinite variable 0.5 ... 0.98 of setting value
at DC: Infinite variable 0.5 ... 0.96 of setting value

Accuracy:
Response value at
Potentiometer right stop (max): 0 ... + 8 %
Potentiometer left stop (min): - 10 ... + 8 %

Repeat accuracy
(constant parameter): ≤ ± 0.5 %

Recovery time
at devices with manual reset
(Reset by braking of the auxiliary voltage)
BA 9054/6_ _ : ≤ 1 s
(dependent to function and auxiliary voltage)
Infinite variable at logarithmic scale
from 0 ... 20 s, 0 ... 30 s, 0 ... 60 s, 0 ... 100 s
setting 0 s = without time delay

Time delay t_v :

Start-up delay t_a :
BA 9054/1_ _ : 1 ... 20 s; 1 ... 60 s; 1 ... 100 s,
adjustable on logarithmic scale.
 t_a is started when the supply voltage is connected. During elapse of time the output contact is in good state

Auxiliary voltage U_H (A1, A2)

Nominal voltage	Voltage range	Frequency range
AC/DC 24 ... 80 V	AC 18 ... 100 V	45 ... 400 Hz; DC 48 % W
	DC 18 ... 130 V	$W \leq 5 \%$
AC/DC 80 ... 230 V	AC 40 ... 265 V	45 ... 400 Hz; DC 48 % W
	DC 40 ... 300 V	$W \leq 5 \%$

Nominal voltage	Voltage range	Frequency range
DC 12 V	DC 10 ... 18 V	battery voltage

Nominal consumption: 4 VA; 1.5 W at AC 230 V Rel. energized
1 W at DC 80 V Rel. energized

Auxiliary voltage U_H (A1, A2) for mono voltages

Technical Data

Nominal voltage: AC 24, 42, 110, 127, 230, 400 V
Voltage range: 0.8 ... 1.1 U_H
Nominal frequency: 50 / 60 Hz^H
Frequency range: ± 5 %
Nominal consumption: 2.5 VA

Output

Contacts: 2 changeover contacts
Thermal current I_{th} : 2 x 5 A
Switching capacity
to AC 15:
NO contact: 2 A / AC 230 V IEC/EN 60947-5-1
NC contact: 1 A / AC 230 V IEC/EN 60947-5-1
to DC 13:
1 A / DC 24 V IEC/EN 60947-5-1
Electrical life
at 3 A, AC 230 V cos φ = 1: 2 x 10⁵ switching cycles
Short-circuit strength
max. fuse rating: 6 A gG / gL IEC/EN 60947-5-1
Mechanical life: 30 x 10⁶ switching cycles

General Data

Operating mode: Continuous operation
Temperature range:
Operation: - 40 ... + 60 °C
(higher temperature with limitations on request)
Storage: - 40 ... + 70 °C
Altitude: ≤ 2000 m

Clearance and creepage distances

Overvoltage category

Measuring voltage
≤ 600 V: III
> 600V: II

Rated impulse voltage / pollution degree

Aux. voltage / measuring input: 6 kV / 2 IEC 60664-1
Auxiliary voltage / contacts: 6 kV / 2 IEC 60664-1
Measuring input / contacts: 6 kV / 2 IEC 60664-1
Contacts 11,12,14 / 21, 22, 24: 4 kV / 2 IEC 60664-1

EMC

Electrostatic discharge: 8 kV (air) IEC/EN 61000-4-2
HF irradiation
80 MHz ... 1 GHz: 20 V/m IEC/EN 61000-4-3
1 GHz ... 2.7 GHz: 10 V/m IEC/EN 61000-4-3
Fast transients: 4 kV IEC/EN 61000-4-4

Surge voltages

between
wires for power supply: 2 kV IEC/EN 61000-4-5
between wire and ground: 4 kV IEC/EN 61000-4-5
HF wire guided: 10 V IEC/EN 61000-4-6
Interference suppression: Limit value class B EN 55011

Degree of protection

Housing: IP 40 IEC/EN 60529
Terminals: IP 20 IEC/EN 60529

Housing:

Thermoplastic with V0 behaviour according to UL subject 94
Vibration resistance: Amplitude 0.35 mm IEC/EN 60068-2-6
frequency 10 ... 55 Hz

Climate resistance:

40 / 060 / 04 IEC/EN 60068-1

Terminal designation:

Wire connection:

2 x 2.5 mm² solid or
2 x 1.5 mm² stranded wire with sleeve
Plus-minus terminal screws M3,5 with self-lifting clamping piece IEC/EN 60999-1

Stripping length:

Fixing torque:

10 mm
0.8 Nm IEC/EN 60715

Mounting:

DIN-rail
Weight
AC-device: 280 g
AC/DC-device: 200 g

Dimensions

Width x height x depth: 45 x 75 x 120 mm

Classification to DIN EN 50155

Vibration and shock resistance: Category 1, Class B IEC/EN 61373
Ambient temperature: OT1, OT2 compliant
 OT3 and OT4 with operational limitations
Protective coating of the PCB: No

CCC-Data

Thermal current I_{th} : 5 A
Switching capacity
 to AC 15: 2 A / AC 230 V IEC/EN 60 947-5-1
 to DC 13: 1 A / DC 24 V IEC/EN 60 947-5-1



Technical data that is not stated in the CCC-Data, can be found in the technical data section.

Standard Types

BA 9054/010 AC 25 ... 250 V AC/DC 80 ... 230 V
 Article number: 0053642
 • for Overvoltage monitoring
 • Measuring range: AC 25 ... 250 V
 • Auxiliary voltage U_{H^+} : AC/DC 80 ... 230 V
 • Time delay t_v by U_{an} : 0 ... 20 s
 • Width: 45 mm

BA 9054/012 AC 25 ... 250 V AC/DC 80 ... 230 V
 Article number: 0053714
 • for Undervoltage monitoring
 • Measuring range: AC 25 ... 250 V
 • Auxiliary voltage U_{H^+} : AC/DC 80 ... 230 V
 • Time delay t_v by U_{ab} : 0 ... 20 s
 • Width: 45 mm

Ordering Example for Variants

BA 9054 /	AC 25 ... 250V	AC/DC	80 ... 230 V	0 ... 20 s	1 ... 20 s
				Start up delay t_a Time delay t_v Auxiliary voltage Measuring range	
				10	Overvoltage relay energized on trip time delay at setting value
				11	Overvoltage relay de-energized on trip time delay at setting value
				12	Undervoltage relay energized on trip time delay at hysteresis value
				13	Undervoltage relay de-energized on trip time delay at hysteresis value
				20	Same as BA 9054/024, but with additional moisture protection
				21	Same as BA 9054/011, overloadable up to AC/DC 1000 V, 1 C/O contact
				22	Same as BA 9054/012, overloadable up to AC/DC 1000 V, 1 C/O contact
				23	Same as BA 9054/013, overloadable up to AC/DC 1000 V, 1 C/O contact
				24	Same as BA 9054/010, overloadable up to AC/DC 1000 V, 1 C/O contact
				32	Same as BA 9054/022, with 4 x AC/DC 500 V input resistances in series
				46	Same as BA 9054/010, reduced reaction-time, measuring range DC 24 ... 35 V, it is necessary to connect power supply before measuring voltage
				47	Same as 46, but with measuring range DC 60 ... 78 V
				0	Standard version
				1	With start up delay t_a
				2	With safe electrical separation of input- and output circuit according to DIN 61140 (on req.)
				6	With manual reset, resetting by disconnecting the power supply
					Type

Setting

Example:

Voltage relay AC 25 ... 250 V

AC according to type plate:

i.e. the unit is adjusted to AC voltage
25 ... 250 V = measuring range

Response value AC 150 V

Hysteresis AC 75 V

Settings

upper potentiometer: 0.6 (0.6 x 250 V = 150 V)

lower potentiometer: 0.5 (0.5 x 150 V = 75 V)

The AC-devices can also monitor DC voltage. The scale offset in this case is: $\bar{U} = 0.9 \times U_{\text{eff}}$.

AC 25 ... 250 V is equivalent to DC 22.5 ... 225 V

Response value DC 150 V


Hysteresis DC 75 V

Settings

upper potentiometer: 0.66 (0.66 x 225 V = 150 V)

lower potentiometer: 0.5 (0.5 x 150 V = 75 V)

Characteristic

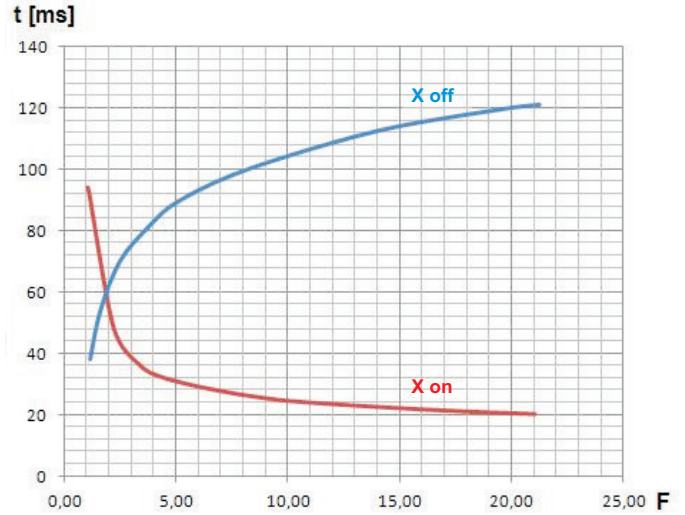

Time delay of measuring circuit

X on: Measured value rises $F = \frac{\text{Meas. value (after rise of meas. value)}}{\text{Setting value}}$

X off: Measured value drops $F = \frac{\text{Meas. value (befor meas. value drops)}}{\text{Setting value (hysteresis)}}$

The diagram shows the typical delay of a standard devices depending on the measured values "X on and X off" at sudden rise or drop of the signal. At slow change of the measured value the delay is shorter. The total reaction time of the device results from the adjustable delay t_d and the delay created by the measuring circuit.

The diagram shows an average delay. The delay times could differ on the different variants.

Example for "X on" (overvoltage detection with BA9054/010):

Adjusted setting value X on = 230 V.

Caused by a missing neutral the voltage rises suddenly to 400 V

$$F = \frac{\text{Measured value (after rise of meas. value)}}{\text{Setting value}} = \frac{400 \text{ V}}{230 \text{ V}} = 1,74$$

Reading from the diagram:

The output relay switches on after 64 ms at a setting $t_d=0$.

Example for "X off" (undervoltage detection with BA9054/012):

Adjusted hysteresis setting value is 100 V.

Caused by a broken wire the voltage drops suddenly from 230 V to 0 V.

$$F = \frac{\text{Measured value (befor meas. value drops)}}{\text{Setting value (hysteresis)}} = \frac{230 \text{ V}}{100 \text{ V}} = 2,3$$

Reading from the diagram:

The output relay switches off after 70 ms at a setting $t_d=0$.

